

8

7

6

5

4

3

2

1

H

G

F

E

D

C

B

A

H

G

F

E


D

C

B

A

REV	DESCRIPTION	ECN#	BWN	APVD	DATE
A	ISSUED DRAWING	572	KJK	KJK	02NOV08
B	ADDED CHANGES FROM C071360 REV B, C, D, E. ADDED LOW SUCTION PRESSURE ALARM CIRCUIT: R313, WIRES B743J, J754T, G5616, G313 WITH DCB, AND INTER-CONNECT TERMINAL R313. ADDED GROUND WIRES J711B & J711C.	1612	MJD	KJK	15MAR10
C	ADDED LSAD, RLSP, AND AFFECTED CIRCUITS	2637	MJD	MJD	21JUN12
--	RELOCATED LOW SUCTION ALARM DRIVER OFF	2637	MJD	MJD	16SEP15

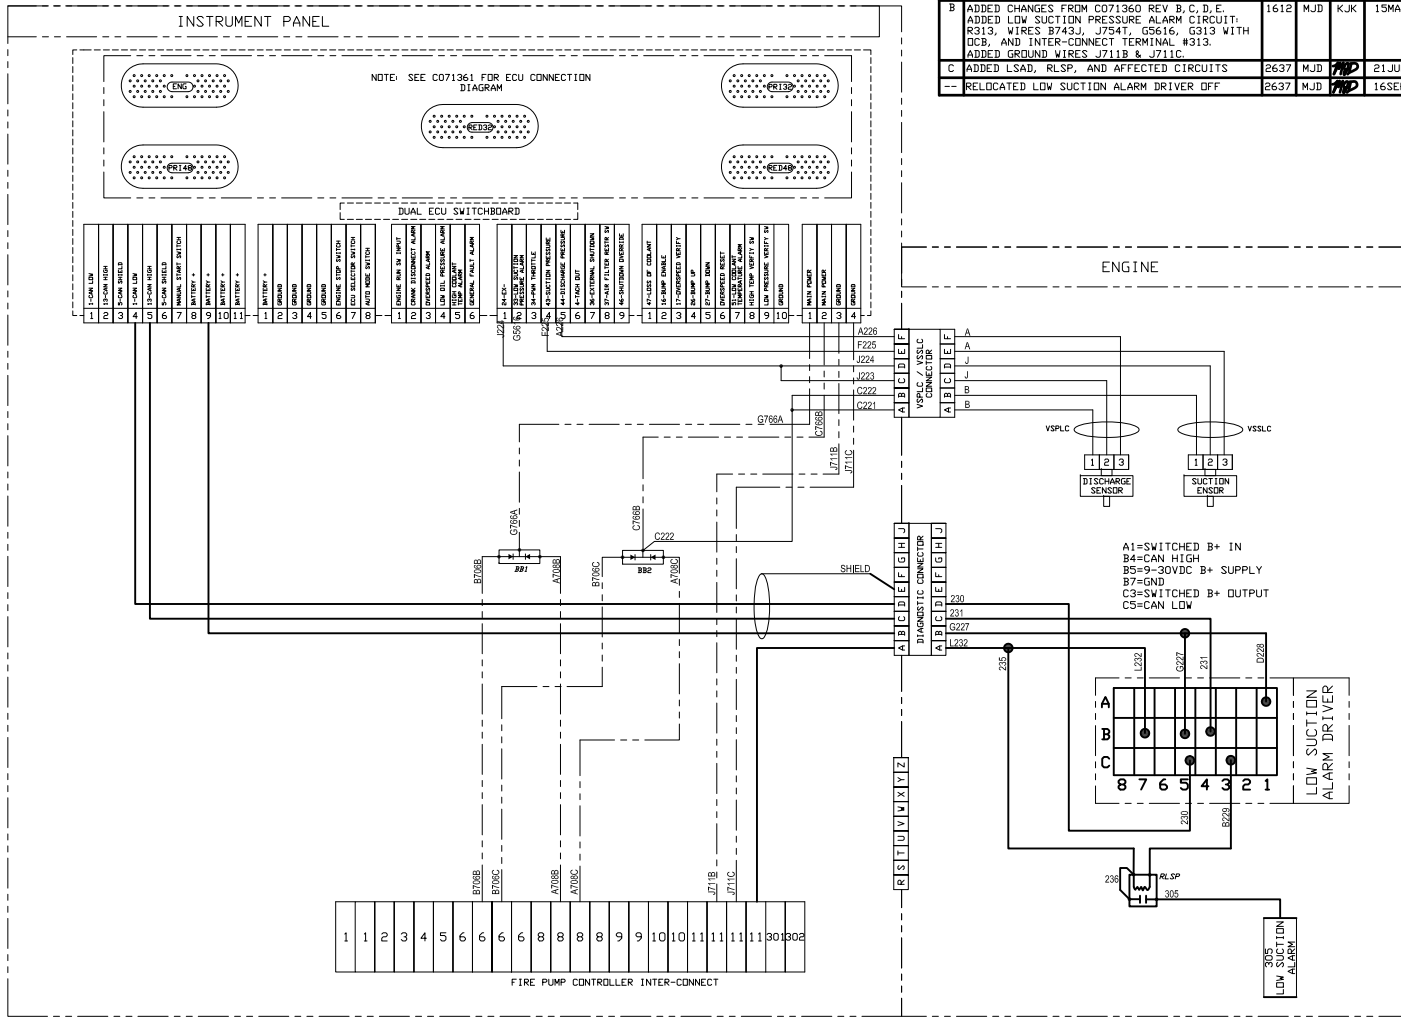

THIS DRAWING AND THE INFORMATION HEREON ARE THE PROPERTY OF CLARKE AND MAY BE USED BY OTHERS ONLY AS AUTHORIZED BY THE ORIGINAL DRAWING. RIGHTS RESERVED UNDER THE COPYRIGHT LAWS.

CLARKE Fire Protection Products, Inc.

CONTROLLED DRAWING

WIRING DIAGRAM, ELECTRONIC VSP/LC/VSS/LC OPTION C071372

DESIGNED BY: KJKUNKLER
 DATE: 02NOV08
 ENGINEER: KJKUNKLER
 MATERIAL: _____
 PART NO: _____
 USED ON / LAYOUT PART NO: _____
 SCALE: NTS
 UNITS: MM (INCH)
 PAGE 1 OF 1

8

7

6

5

4

3

2

1